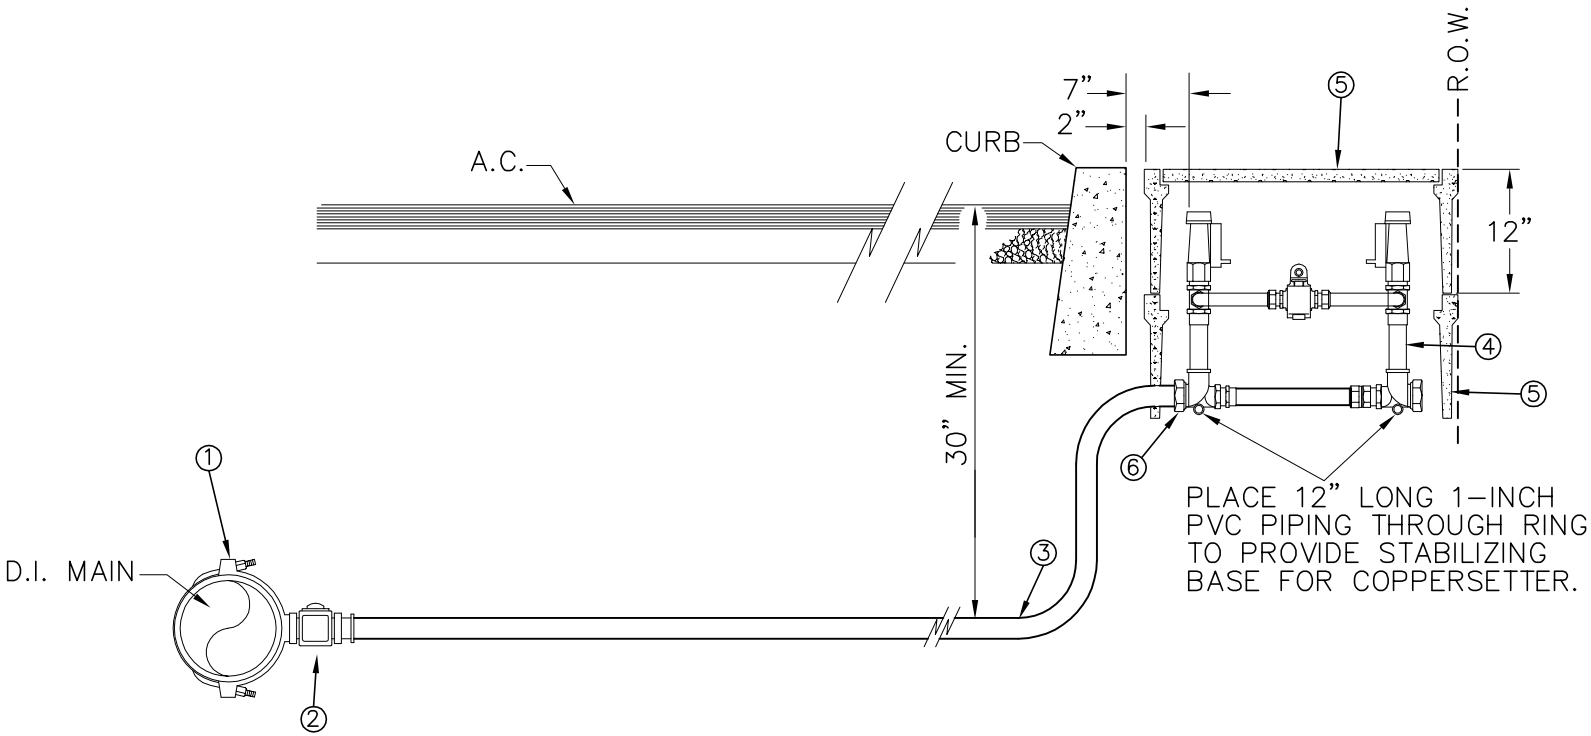

MATERIALS:

1. SERVICE SADDLE.
2. MUELLER H15023 CORP. STOP
3. 2" ASTM TYPE K HARD COPPER.
4. MUELLER COPPER METER YOKE, #H-1423-2-99000, 24" RISER SIZED TO EQUAL SERVICE LINE.
5. BROOKS METER BOX, #65-H MBC FOR 1 1/2" AND #66-S MBC FOR 2" INSTALLATION.
6. MUELLER H-15428.

NOTES:

1. SUBSTITUTES FOR ANY MATERIALS SHOWN SHALL BE APPROVED BY THE PUBLIC WORKS DIRECTOR.
2. ALL PIPE AND STRUCTURE ZONES SHALL BE BACKFILLED USING 3/4" MINUS CRUSHED AGG. AND COMPACTED TO 95% MAX. DENS. AS DETERMINED BY ASHTO T-180.
3. METER BOX SHALL BE CENTERED OVER THE COMPLETED METER AND FITTING ASSEMBLY.

NORTH PLAINS City to the Sunset

DATE:	BY:	REVISION

STANDARD 1½" – 2" SINGLE SERVICE

SCALE:	APPVD:	DATE:	DWG NO.:
N.T.S	BAB	10/05	315