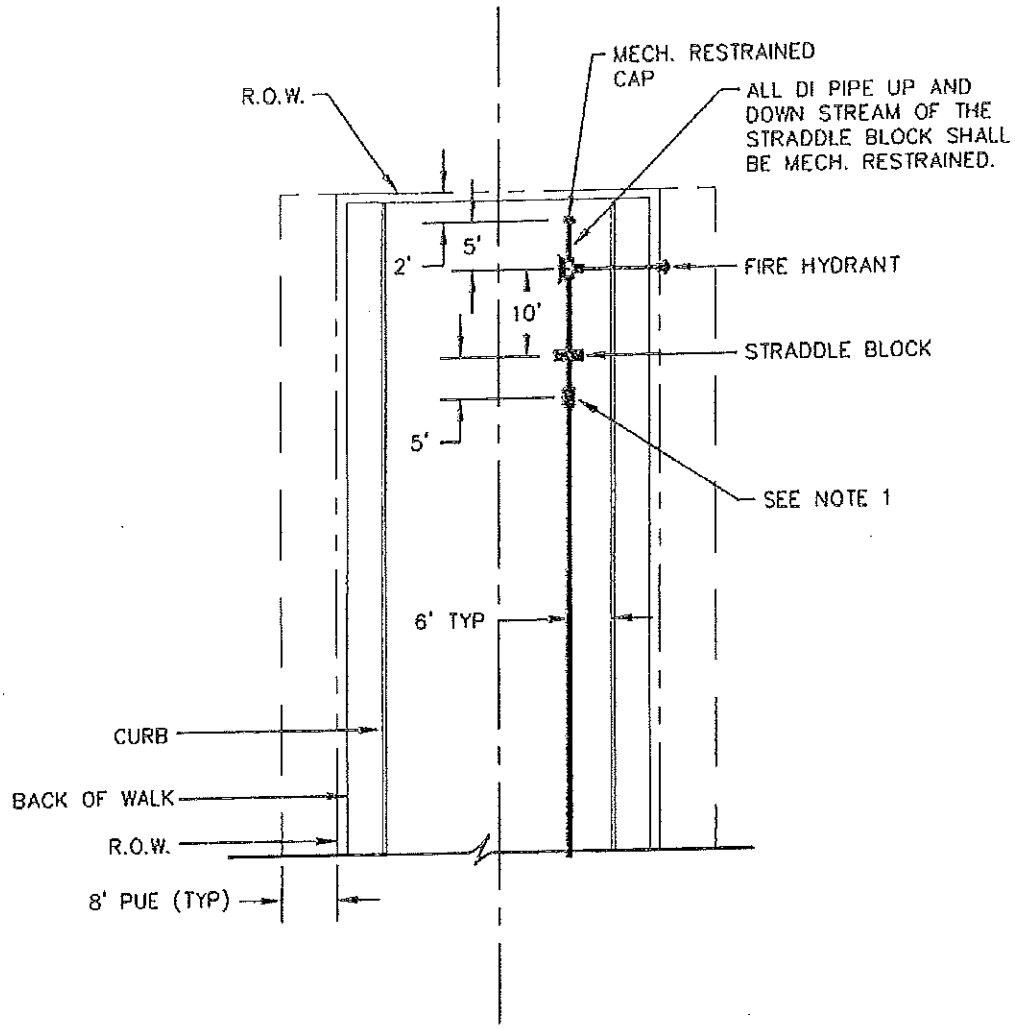

NOTE:

1) FOR DEAD END LINE SERVING CUSTOMERS THAT MAY/WILL BE EXTENDED IN THE FUTURE:
   - INSTALL GATE VALVE SIZED AT FULL PIPE DIAMETER WHERE SHOWN.
   - USE MJ x MJ GATE VALVE.

DATE:	BY:	REVISION

FIRE HYDRANT BLOWOFF

SCALE:	N.T.S
APPVD:	BAB
DATE:	10/05
DWG NO.:	321

\04\0682\100 General Services\CAD\X-1.dwg Oct/31/05