G:\PDX_Projects\04\0682\100 Planning\CAD\NP Std Details\X-1.dwg Jun/27/16

NORTH PLAINS
City to the Sunset

DATE:	BY:	REVISION

STANDARD BLOWOFF
Future Construction

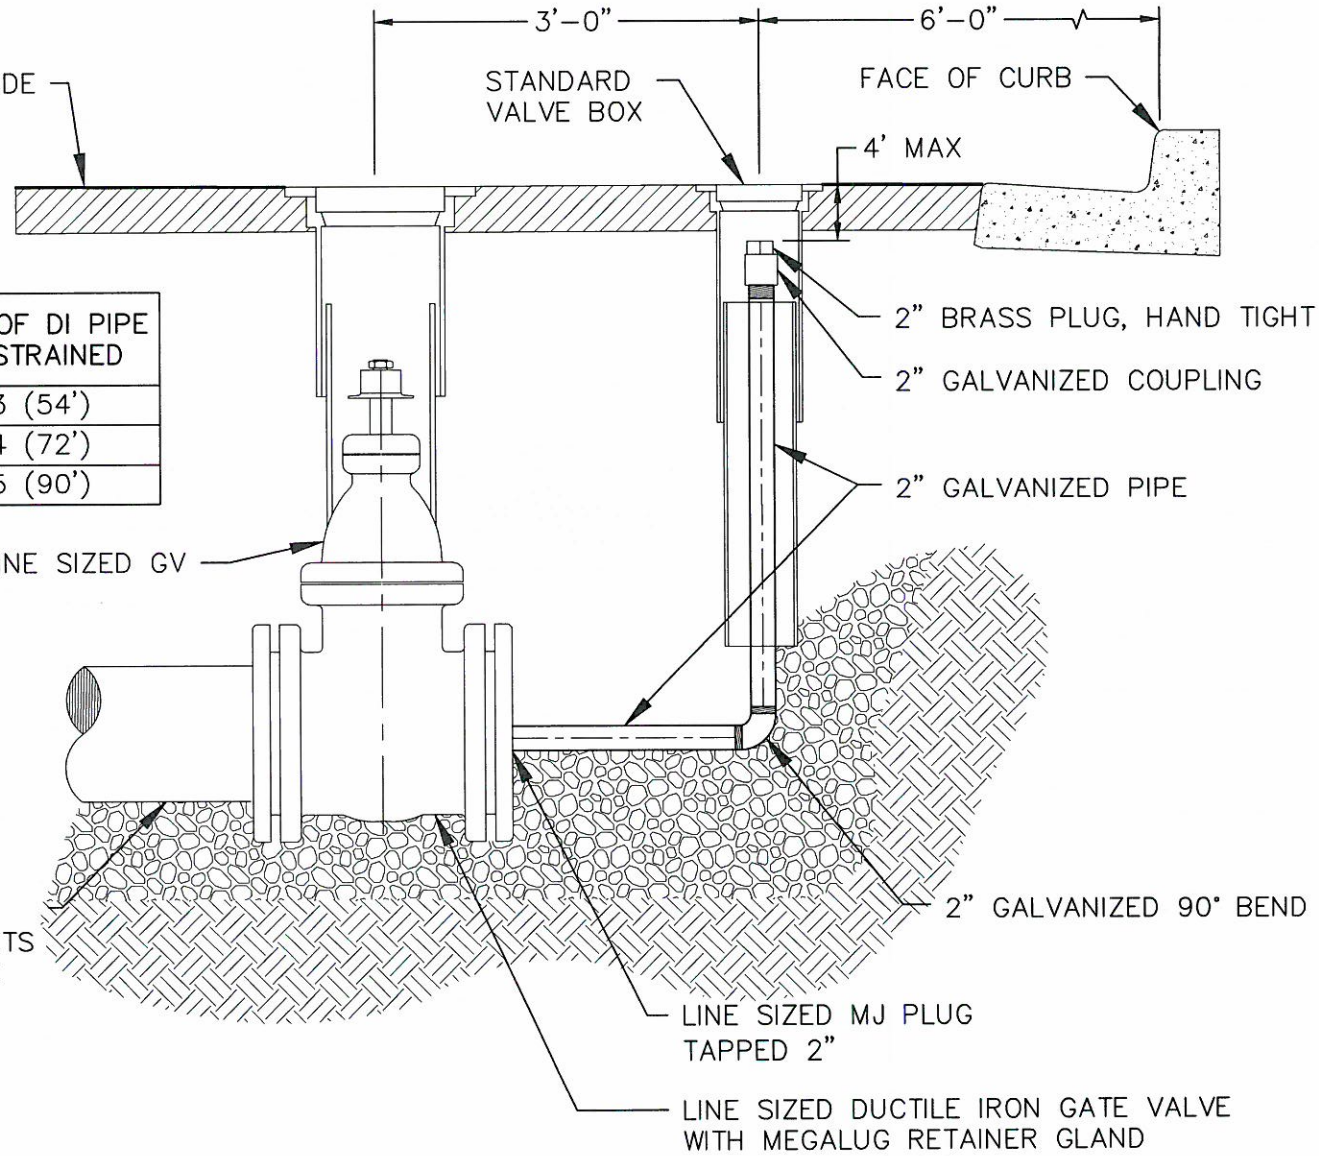

PIPE SIZE	NO. OF DI PIPE RESTRAINED
8"	3 (54')
12"	4 (72')
16"	5 (90')

NOTES:

1. BACKFILL WILL BE COMPACTED 90% ¾" GRAVEL, WITH MINIMUM 36" COVER.

2. PROVIDE 24" SQUARE BY 4" THICK CONCRETE AROUND VALVE BOX OUTSIDE PAVED AREAS.

SCALE:	APPVD:	DATE:	DWG NO.:
N.T.S	BAB	10/05	318